





## Application Note

### Use of 101N0230 Electronic Unit



In applications providing pressure equalization before compressor start and operating in ambient conditions below 32°C (90°F), electronic unit 101N0210 is appropriate for both the BD35F and BD50F compressors. Electronic unit 101N0230 is offered for use with Danfoss BD50F compressors to provide additional starting torque for the

BD50F compressor. Electronic unit 101N0230 is not suitable for use with the BD35F compressor. The BD50F has a stronger motor than the BD35F and can tolerate the higher start current furnished by the 101N0230 electronic unit.

#### Starting current for 101N0210 (BD35F & BD50F)

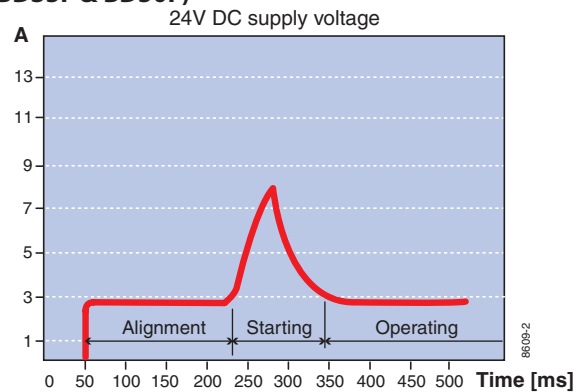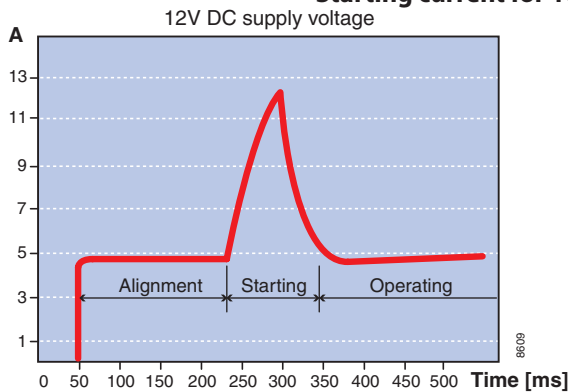

#### Starting current for 101N0230 (BD50F)

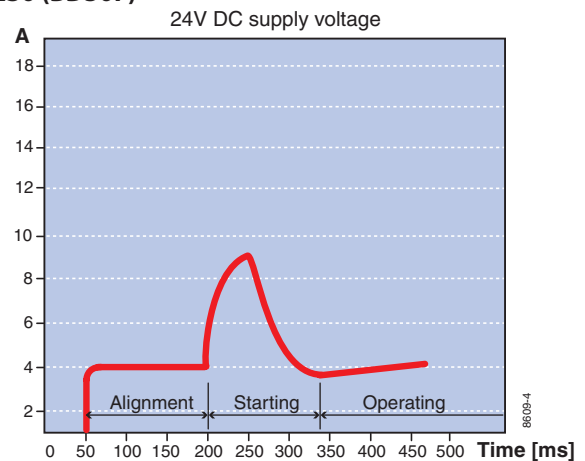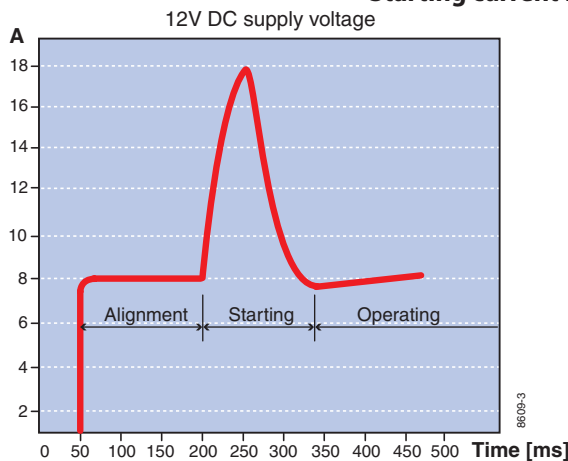

Danfoss can accept no responsibility for possible errors in catalogues, brochures and other printed material. Danfoss reserves the right to alter its products without notice. This also applies to products already on order provided that such alterations can be made without subsequential changes being necessary in specifications already agreed. All trademarks in this material are property of the respective companies. Danfoss and the Danfoss logotype are trademarks of Danfoss A/S. All rights reserved.